

Guided microwave level measurement device - sanitary version



Type 8189 can be combined with...




Type 8619

multiCELL
Transmitter/Controller



Type 2035

Diaphragm valve

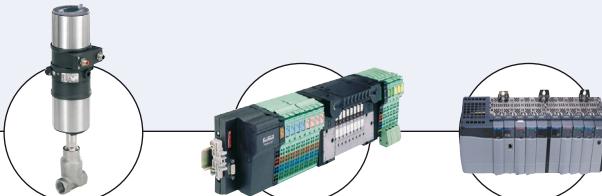

Type 8802-GD

Continuous
TopControl system



Type 8644

Valve islands



PLC



- Universal level measurement device for liquids
- Liquid interface measurement
- Insensitive to dust and steam
- 4... 20 mA/Hart - 2 wires, ATEX/IECEx approvals

The Type 8189 is a level measurement device with interchangeable rod probe, designed for continuous level measurement. The unit is suitable for liquids, for industrial use in all areas of process technology. But the main application targets are in Food and Beverage (F&B) and pharmaceutical tanks to the new rod in stainless steel 1.4435 with $Ra < 0.76 \mu\text{m}$. For applications with corrosive liquids a PFA coated version is available.

Even process conditions such as strong steam generation, density fluctuations or changes of the dielectric constant do not influence the accuracy of the measurement.

Build-up or condensation on the probe or vessel wall do not influence the measurement result.

General data

Materials

Housing / Cover	PBT, Stainless steel 316L (1.4404) / PC
Seal ring / Ground terminal	NBR / Stainless steel 316L
Wetted parts	
Process fitting / process seal	Stainless steel 316L (1.4404 or 1.4435) and PEEK / EPDM
Rod-Ø 8 mm - polished	Stainless steel 316L (1.4435)

Rod surface finish

$Ra < 0.76 \mu\text{m} (\text{BN}_2)$

Display

LCD in full dot matrix

Weight

890 g
approx. 400 g/m

Process fitting

Clamp 2" or DIN11851 DN50

Length

0.3... 4 m - Lateral load: 10 Nm

Electrical connections

Cable gland M20 x 1.5

Measurement type

Level of liquids

Min. dielectric figure

$\epsilon_r > 1.6$

Dead band

From top of probe: 80 mm - from bottom of probe: 0 mm
From top of probe: 150 mm - from bottom of probe: 100 mm

Measurement range

0.08... 4 m (see diagram on next page)

Process temperature

-20 to 150 °C (-4 to 302 °F)

Process pressure

-1 to 16 bar (-14.51 to 232.16 PSI) (-100... 1600 kPa) (depends on the process fitting)

Temperature drift

0.03 %/10K (Relating to the max. measurement range)

Repeatability

< ± 1 mm


Deviation

± 2 mm (see deviation diagram, on next page)

Electrical data	
Operating voltage (U_n)	9.6 - 35 V DC or 9.6 - 30 V DC (Ex ia instrument)
Output signal	4... 20 mA/HART [Range of the output signal 3.8... 20.5 mA/HART (default setting)]
Resolution	0.3 μ A
Fault signal (adjustable)	Last valid measured value or ≥ 21 mA or ≤ 3.6 mA
Current limitation	21.5 mA (max. output current)
Load	$(U_n - U_{min.})/0.0215$ A
Integration time (63% of the input variable)	0... 999 s, adjustable
Environment	
Ambient temperature	-40 to +80 °C (-4 to 176 °F) (operation and storage)
with display, adjustment elements	
Relative humidity	max. 75 % (operation), max. 85 % (storage); without condensation
Standards and approvals	
Protection	IP66/IP67 with M20 x 1.5 gland mounted and tightened
Oversupply category	III (IEC 61010-1)
Protection class	III (IEC 61010-1)
Standard	
EMC / Safety	EN61326 / EN61010-1
ATEX ¹⁾	EN60079-0; EN60079-11; EN60079-26
NAMUR	NE 21; NE 43
Approvals	FDA
Specifications Ex	
Ex - Protection	Categories 1 G, ½ G or 2 G
Ex - Certification	Ex ia IIC T6
Conformity specifications¹⁾	
Operating voltage U_i	30 V
Short circuit rating i_s	131 mA
Power limitation P_i	983 mW
Ambient temperature	-50 to +46 °C (-40 to 105.8 °F) (depend on categories)
Internal capacity C_i	negligible
Internal inductivity L_i	$\leq 5 \mu$ H

1) homologation certificate IECEX TUR 14.0014 X / TÜV 14 ATEX 7490 X

Measurement range diagram

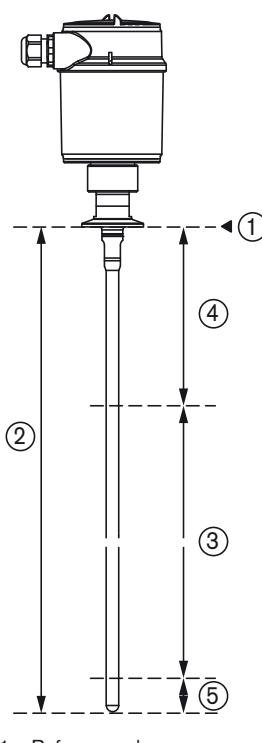


- 1 Reference plane
- 2 Probe length
- 3 Measurement range
- 4 Upper dead band
- 5 Lower dead band

Deviation diagram


Rod probe version in water

- ① Dead band - no measurement possible in this area
- L Probe length

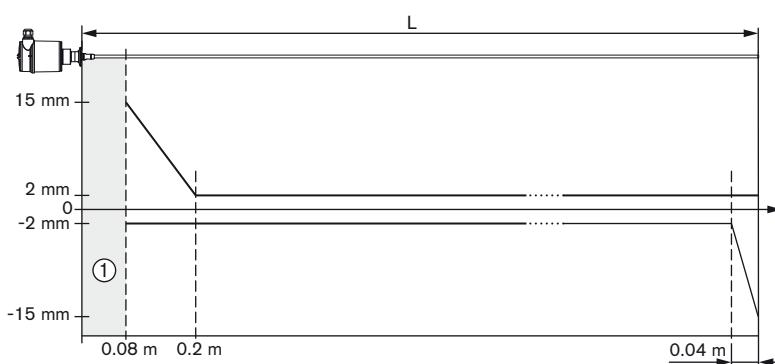


Rod probe version in oil

- ① Dead band - no measurement possible in this area
- L Probe length

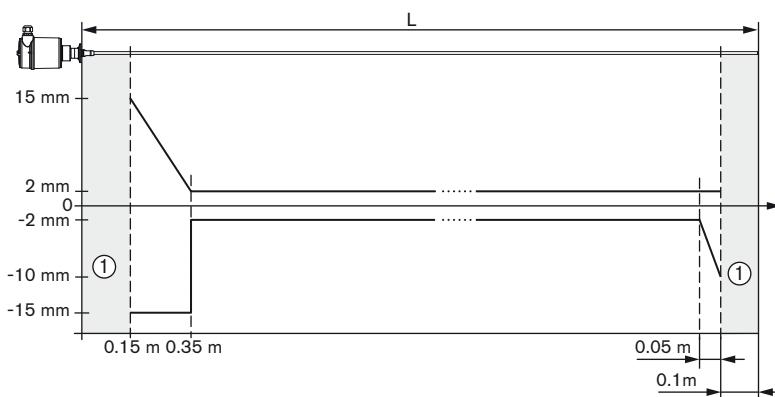


Load diagram

- 1 HART load
- 2 Voltage limit Ex ia instrument
- 3 Voltage limit non-Ex instrument
- 4 Supply voltage

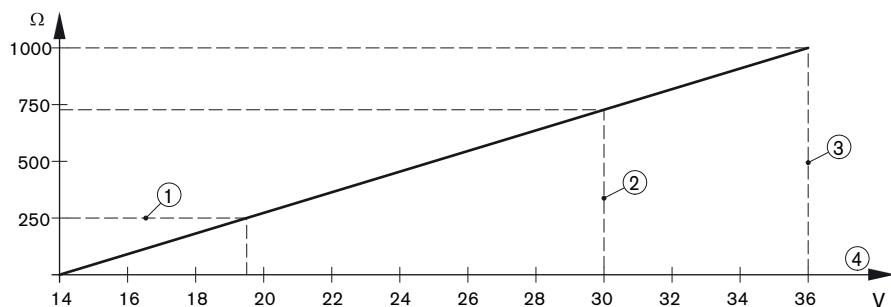
**Target applications with Type 8189****Foodstuffs and animal feed**

Products such as beer, milk, wine, cereals, sugar, flour, coffee, cornflakes, cacao, instant powder, animal feed - liquids or bulk solids levels must be measured everywhere in the food industry.

The microwave principle works independent of products characteristics such as moisture, intense dust or noise generation, density, temperature, over-pressure, foam dielectric value and the shape of the material cone.

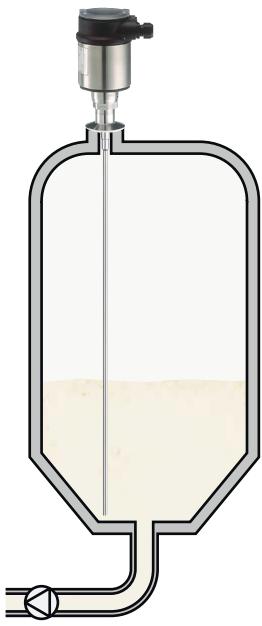Application examples

Level measurement in a milk vessel

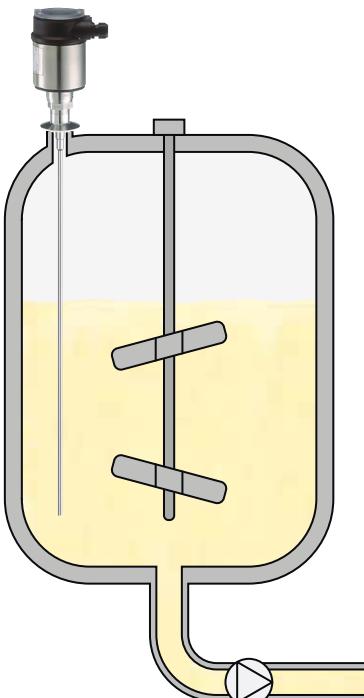

Level measurement in an ice cream vessel

Principle of operation

High frequency microwave pulses are guided along a rod. When they reach the product surface, the microwave pulses are reflected and received by the processing electronics. The running time is evaluated by the instrument and outputted as distance.
Time consuming adjustment with medium is not necessary. The instruments are preset to the ordered probe length.
The shortenable rod versions can be adapted individually to the local requirements.


The measuring device can be adjusted with:

- the display/configuration module
- the suitable Bürkert DTM in conjunction with adjustment software according to the FDT/DTM standard, e.g. PACTware™ and PC.
- a HART handheld

The entered parameters are generally saved in the measuring device Type 8189. Optionally, parameters may also be uploaded and downloaded with the display/configuration module or in PACTware™

► Set up with display/configuration module

The display/configuration module can be inserted into the measuring device and removed again at any time. It is not necessary to interrupt the power supply. The measuring device is adjusted via the four keys of the display/configuration module

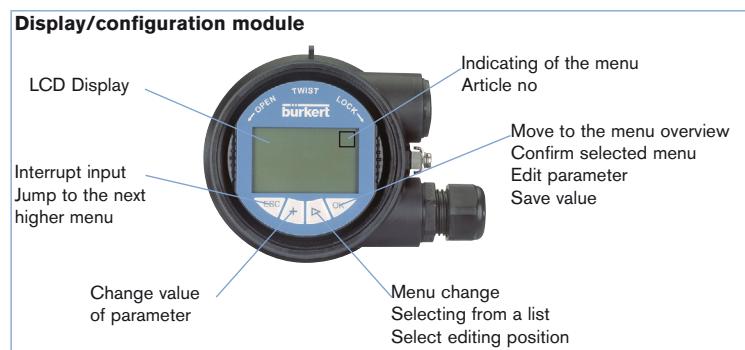

► Set up with PACTware™/DTM and HART communication


The measuring device can be operated thanks to PACTware™, via the HART signal. An interface adapter is necessary for the adjustment with PACTware™. For the setup of the Type 8189, DTM-Collection in the actual version must be used. The basic version of this DTM Collection incl. PACTware™ is available as a free-of-charge download from the Internet at www.burkert.com.

Connecting the PC via HART

1. Measuring device 8189
2. HART-USB Modem
3. Resistance 250 Ohms


Necessary components:

- Measuring device 8189
- PC with PACTware™ and suitable Bürkert DTM
- HART-USB Modem
- Resistance approx. 250 Ohms
- Power supply unit

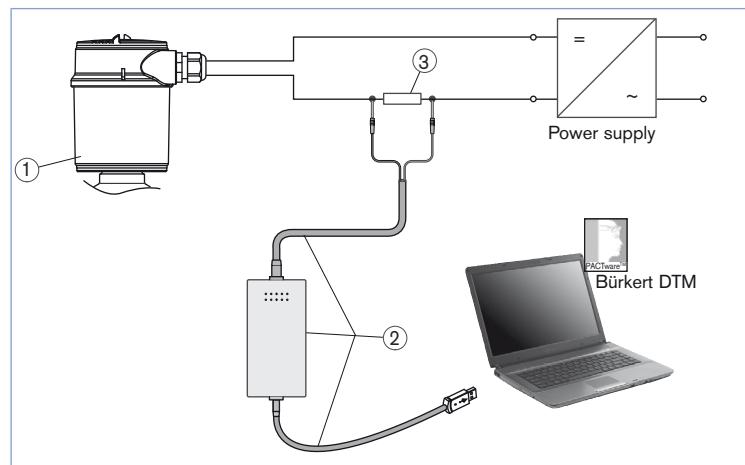


Dimensions [mm]

with Clamp connection

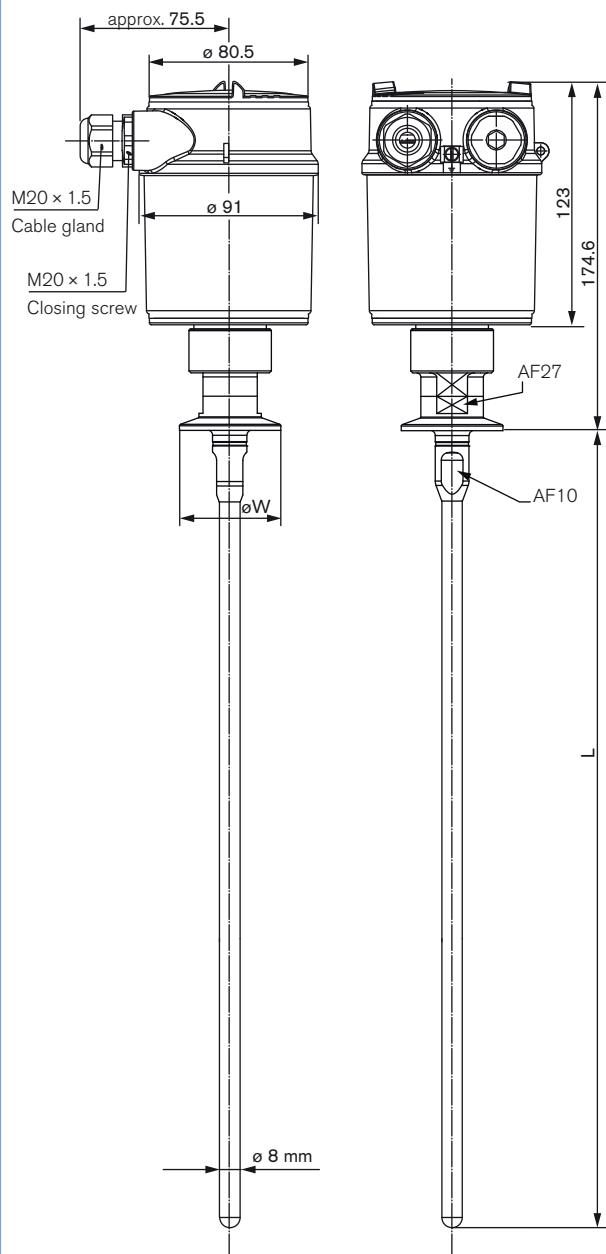

with DIN 11851 connection

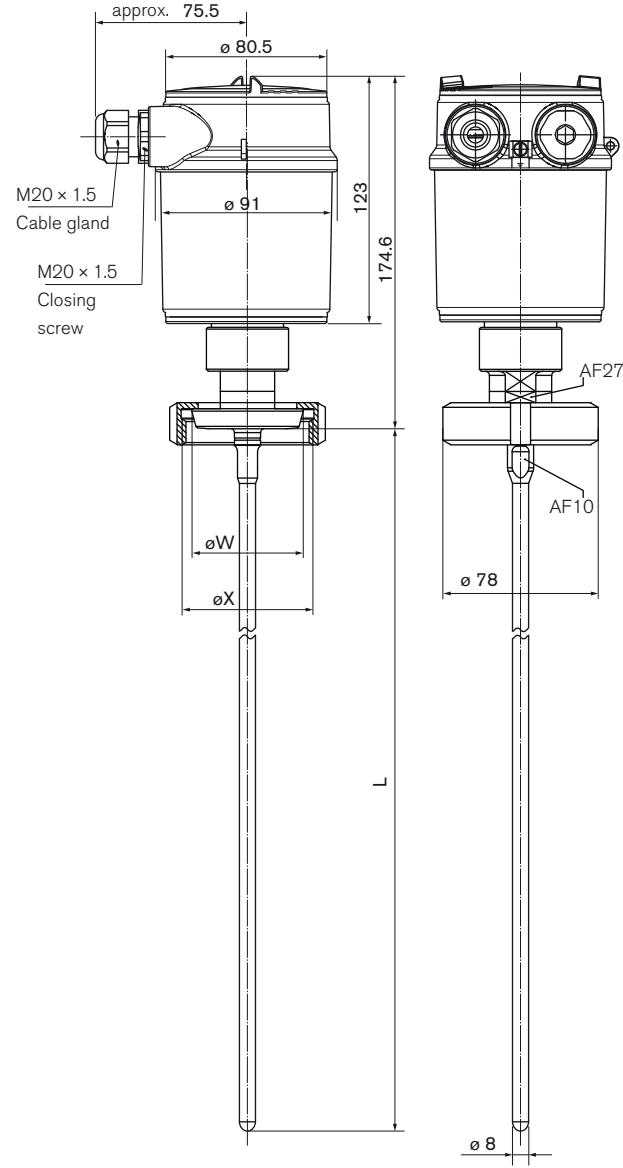

Clamp connection	Ø W	L
1", 1 1/2"	50.5	0.3... 4 m
2"	64.0	
2 1/2"	77.5	
3"	91.0	

DIN 11851 connection	Ø W	Ø X	L
DN32	50.0	Rd 58 x 1/6	0.3... 4 m
DN40	56.0	Rd 65 x 1/6	
DN50	68.5	Rd 78 x 1/6	
DN65	86.0	Rd 95 x 1/6	

Ordering chart for compact measurement device Type 8189

Specifications	Voltage supply	Output	Probe	Length	Electrical connection	Article no. with display/configuration module
Clamp 2"	9.6 - 35 V DC	4 - 20 mA/HART (2 wires)	Rod	1 m	Cable gland M20 x 1.5	565850 ⚒
				2 m	Cable gland M20 x 1.5	565852 ⚒
DIN11851 - DN50	9.6 - 35 V DC	4 - 20 mA/HART (2 wires)	Rod	1 m	Cable gland M20 x 1.5	565851 ⚒
				2 m	Cable gland M20 x 1.5	565853 ⚒
Ex version - ATEX approval - Clamp 2"	9.6 - 30 V DC	4 - 20 mA/HART (2 wires)	Rod	1 m	Cable gland M20 x 1.5	565854 ⚒
				2 m	Cable gland M20 x 1.5	565856 ⚒
Ex version - ATEX approval - DIN11851 DN50	9.6 - 30 V DC	4 - 20 mA/HART (2 wires)	Rod	1 m	Cable gland M20 x 1.5	565855 ⚒
				2 m	Cable gland M20 x 1.5	565857 ⚒
Ex version - IECEx approval - Clamp 2"	9.6 - 30 V DC	4 - 20 mA/HART (2 wires)	Rod	1 m	Cable gland M20 x 1.5	565858 ⚒
				2 m	Cable gland M20 x 1.5	565860 ⚒
Ex version - IECEx approval - DIN11851 DN50	9.6 - 30 V DC	4 - 20 mA/HART (2 wires)	Rod	1 m	Cable gland M20 x 1.5	565859 ⚒
				2 m	Cable gland M20 x 1.5	565861 ⚒

i Further versions on request


Port connection

Clamp 1½", 2½", 3"
DIN 11851 DN32, DN40, DN65


Additional

Without display/configuration module

Ordering chart - accessories for measurement device Type 8189 (has to be ordered separately)

Specifications	Article no.
Set with 2 reductions M20 x 1.5/NPT ½" + 2 neoprene flat seals for cable gland + 2 screw-plugs M20 x 1.5	551782 ⚒
Hart-USB Modem	560177 ⚒
Set with a display/configuration module, a transparent cover and a seal ring	559279 ⚒
Set with a transparent cover and a seal ring	561006 ⚒

Guided microwave level measurement device Type 8189 - request for quotation

Please fill in and send to your local Burkert Sales Centre* with your inquiry or order.

Company:	Contact person:
Customer No.:	Department:
Address:	Tel. / Fax.:
Postcode / Town:	E-mail:

Note

You can fill out
the fields directly
in the PDF file
before printing
out the form.

Guided microwave level measurement device 8189

Quantity:

Desired delivery date:

■ Process connection:

- | | | | | |
|------------------|-------------------------------|-------------------------------|-------------------------------|-------------------------------|
| Clamp | <input type="checkbox"/> 1½" | <input type="checkbox"/> 2" | <input type="checkbox"/> 2½" | <input type="checkbox"/> 3" |
| DIN 11851 | <input type="checkbox"/> DN32 | <input type="checkbox"/> DN40 | <input type="checkbox"/> DN50 | <input type="checkbox"/> DN65 |

■ Sensor version:

- | | | |
|---------------|---|--|
| Length | <input type="checkbox"/> 1 m | <input type="checkbox"/> 2 m |
| | <input type="checkbox"/> Spec. length <input type="text"/> mm | (multiple of 100 mm between 300 and 4000 mm for Rod version) |

■ Display/configuration module

Yes No

■ ATEX approval

Yes No


■ IECEx approval

Yes No

■ FDA approval

Yes No

Interconnection possibilities with other Burkert devices

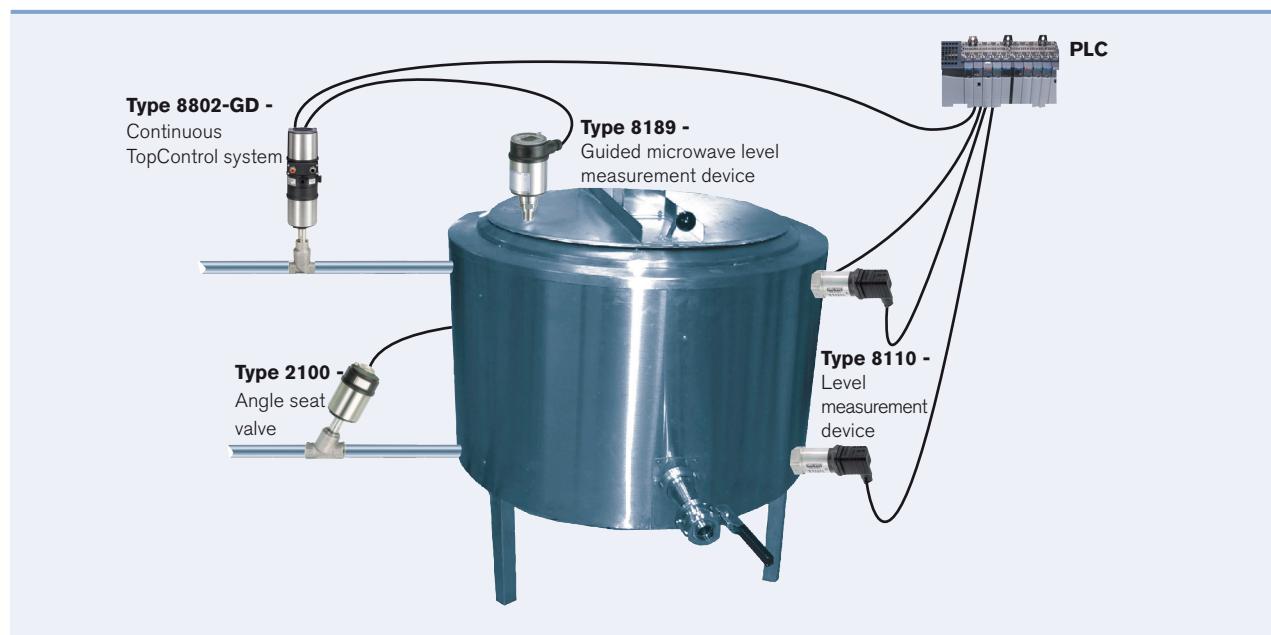

*To find your nearest Burkert facility, click on the orange box →

www.burkert.com

In case of special application conditions,
please consult for advice.

Subject to alteration.
© Christian Burkert GmbH & Co. KG

1803/2_EU-en_00895279